
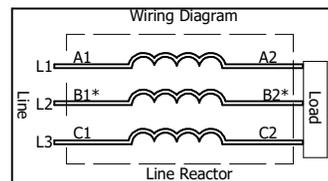
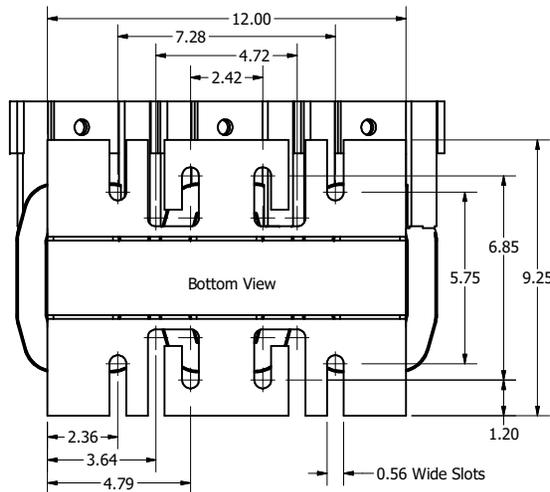
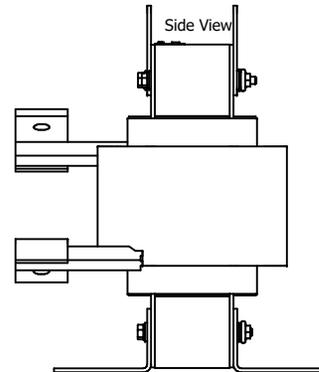


| 480 Rated Voltage, 600 Max Voltage, High Z, Impedance. | | | | | | | | |
|--|-----------------|----------------|------------------|-----------------|--------------|------------|-------------------|-----------------------------|
| Part Number | Horsepower (HP) | Motor Amps (A) | Maximum Amps (A) | Inductance (uH) | Weight (LBS) | Losses (W) | Available Lug Kit | Terminal Hole Size (Inches) |
| KDRL5H | 450 | 515 | 540 | 59.7 | 135 | 774 | SLK14 | 0.53 |
| KDRL6H | 500 | 590 | 590 | 52.5 | 135 | 697 | SLK14 | .053 |

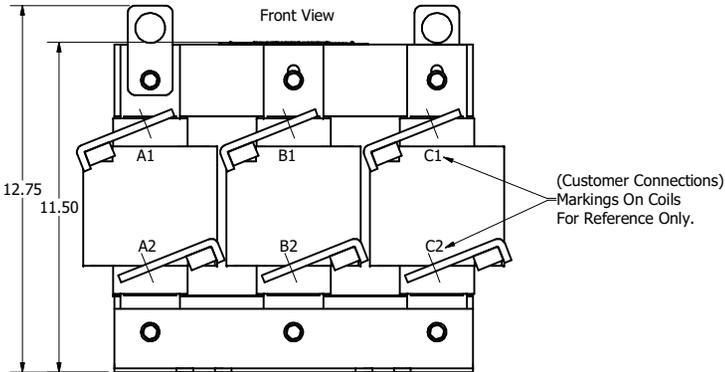

* For single phase applications, use coils A and C, Isolate terminals B1 and B2.

TCI (800) 824-8282 transcoll.com

KDRUL Drive Reactor
 KDR - Vector Amps -
 3PH, 50/60Hz -V Rated, 600V Max, -A Max
 40C Amb Max, 155C Rise, RoHS
 Manual #30895 LUG KIT #SLK-

UL LISTED CE
 200 0000 00 0000

DATE CODE A1 A2 B1 B2 C1 C2

Notes:

1. KDR Lug Kits sold separately. Contact TCI.
2. For KDRUL Version With Terminal Lugs Attached, See Sheet 10
3. UL file number: cULus Listed File E116124.
4. KDR Drive Reactors Comply With The Thermal and Altitude Standards Set Forth by NEMA ST20-1992.
5. KDR IOM Manual Part Number 30895
6. NEC Current For 208/240 Volts, Horsepower Based On 208 Volts.
7. Material(s) Shall be RoHS Compliant
8. Customer Is Responsible For Installation To Meet All National And Local Electrical Codes.

THE INFORMATION AND DESIGNS CONTAINED IN THIS DRAWING ARE CONFIDENTIAL AND THE PROPRIETARY PROPERTY OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES. NEITHER THIS DESIGN NOR ANY INFORMATION CONTAINED IN THIS DRAWING MAY BE REPRODUCED OR DISCLOSED TO OTHERS WITHOUT THE EXPRESS WRITTEN CONSENT OF ALLIED MOTION TECHNOLOGIES INC. AND ITS SUBSIDIARIES.

| NO | REVISION | DATE | BY | SCALE |
|----|-------------------|---------|-----|-------|
| A | Combined drawings | 3/23/18 | DSW | |

TCI W132N10611 (Rev 11/16)
 Germantown, WI 53022
 © 2022 TCI, LLC
 An Official Motors Company
 KDR L-Frame, Copper Bus
 Reactor Drawing
 107537DG
 SCALE: 1/3.2 DRAWN: DSW DATE: 3/23/18
 CHECK: [Signature] DATE: [Blank]